
E3 -10: Sill - External Door - Suspended Slab

Psi Value: 0.195 W/mK

f Value: 0.58

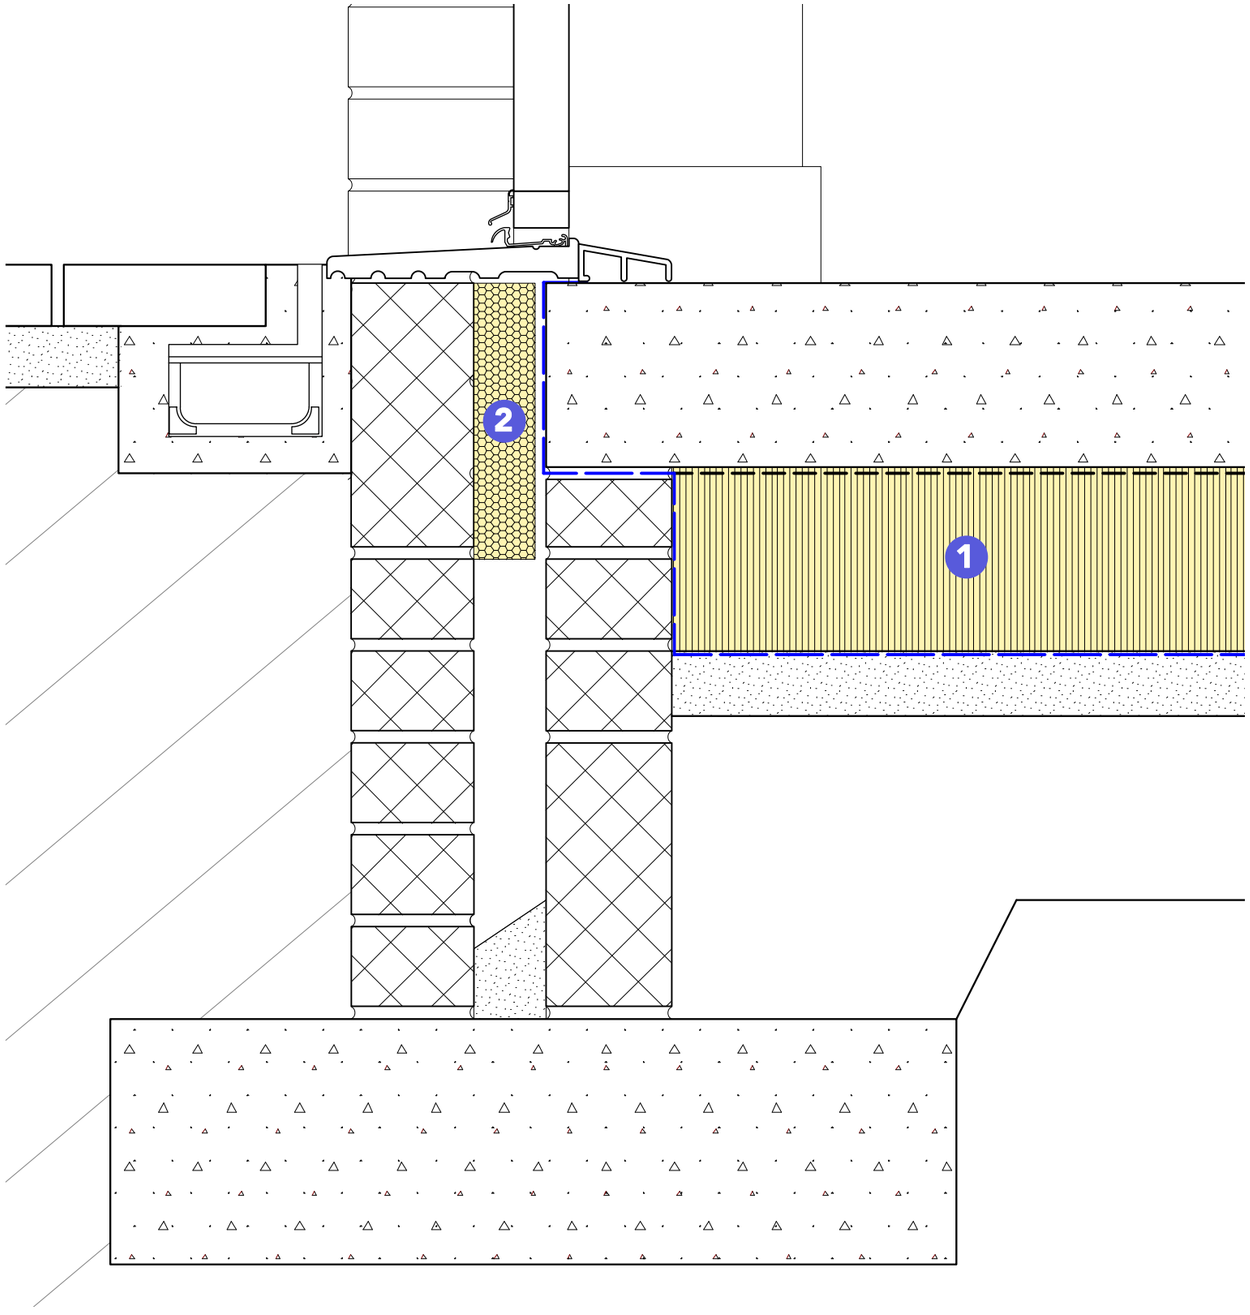

Thermal Compliance Notes

1. 150mm PIR rigid insulation (0.022 W/mK).
2. 50x225mm XPS rigid insulation (0.035 W/mK) locally within cavity under door threshold width only.

Construction Notes

1. The Principal Designer should be aware that this detail may be prone to condensation and mould locally at the door threshold width. In operation, this may or may not materialise, due to door use and the overall thermal performance of the building. This detail can be improved by locally casting the suspended slab short of the inner blockwork wall and using either an insulated block, or high strength insulation material, at the door width.

General Notes

1. The timber frame detailing arrangements shown are considered common industry practice and align with STA technical guidance and advice where required.
2. All non-timber frame construction detailing, design and specifications, are the responsibility of the Principal Designer.
3. Substructure detailing and ground floor construction, is subject to structural engineer's project specific design, under the responsibility of the Principal Designer.