
E17 – Corner (Inverted)

Superglass Superwhite 34 Blown Cavity Insulation

Date of Issue: September 2026

	Wall Build-up	
	Thickness (mm)	**Thermal Conductivity (W/mK)**
Outer Leaf Brickwork	102.5	0.77
Superglass Superwhite 34 Blown Cavity Insulation	Shown in tables below	
Inner Leaf Blockwork	100	Shown in tables below
Plaster Dabs	15	0.088
Standard Plasterboard	12.5	0.19

Linear Thermal Transmittance (Ψ-value) and Temperature Factor (f-value) calculated for a range of block types and insulation thicknesses.

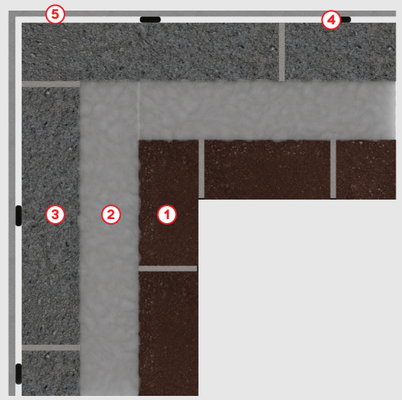

1. 102.5mm Outer Leaf Brickwork
2. Superglass Superwhite 34 Blown
3. 100mm Inner Leaf Blockwork
4. 15mm Plaster Dabs
5. 12.5mm Standard Plasterboard

Images for illustration purposes only.

Superwhite 34 Blown Cavity Insulation - 0.034W/mK											
	Insulation & Cavity Thickness	**100mm**		**125mm**		**150mm**		**175mm (100+75mm)**		**200mm (2x100mm)**	
Block Type	**Thermal Conductivity (W/mK)**	**Ψ-value (W/mK)**	**f-value**	**Ψ-value (W/mK)**	**f-value**	**Ψ-value (W/mK)**	**f-value**	**Ψ-value (W/mK)**	**f-value**	**Ψ-value (W/mK)**	**f-value**
Lightweight Aircrete	0.11	-0.089	0.970	-0.083	0.975	-0.078	0.978	-0.075	0.980	-0.073	0.982
Standard Aircrete	0.15	-0.096	0.968	-0.088	0.973	-0.083	0.977	-0.079	0.980	-0.076	0.982
High Strength Aircrete	0.19	-0.100	0.966	-0.091	0.973	-0.085	0.976	-0.081	0.979	-0.078	0.981
Ultra Lightweight Aggregate	0.28	-0.105	0.965	-0.095	0.972	-0.089	0.976	-0.084	0.978	-0.080	0.981
Medium Dense	0.45	-0.109	0.965	-0.098	0.971	-0.091	0.975	-0.086	0.978	-0.082	0.980
Dense Concrete	1.13	-0.113	0.964	-0.101	0.970	-0.094	0.974	-0.088	0.978	-0.084	0.980

The results have been generated using AutoPsi Thermal Modelling Tool. The calculations have been completed using the methodology outlined in BS EN ISO 10211 and in accordance with BR497 2nd Edition.

Any deviation from the details used as part of this calculation will result in the calculation being inaccurate. To request a copy of a calculation or a different build-up please email technical.stirling@etexgroup.com